


FOR INDICATING TRANSMITTER WIRING DETAILS REFERENCE DRAWING HOW-0050B

***24 VDC SUPPLIES**
 1 SUPPLY MAY BE USED TO POWER MORE THAN 1 INSTRUMENT, EXCEPT:
 IF BARRIERS ARE USED, SUPPLY SHOULD BE DEDICATED TO 1 INSTRUMENT. IF USED FOR 2, TOTAL CURRENT NOT TO EXCEED 20 mA

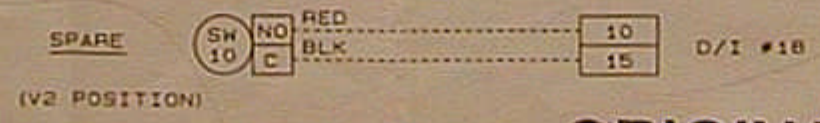

ORIGINAL

CONFIDENTIAL

REV. NO.	REV.	REV. DATE	REVISION DESCRIPTION	DATE	BY	CHK'D	APP'D.
10000	1		REVERSE TRANSMITTER WIRING	10/18/88	SM	JTC	ALB
10000	2		ELIMINATED SWIRY & REVERSED UVIR DETECTOR TERMINAL DESIGNATIONS	04/06/90	SM	JTC	ALB
10000	3		REVERSE WIRING TO REDUCE EXLOR'S INTERFERENCE	08/11/90	SM	MP	ALB

UNLESS OTHERWISE SPECIFIED: FRAC'T. DEC. DIM. 1/8" & 1/4" 1/8" & 1/4" 1/8" & 1/4"	L. E. WALKER DESIGN	10/18/88	11/16	ELECTRICAL 00-450 CONDUIT / MOUNTING ASSEMBLY STANDARD CABINETS	FILE 4007800 30M	DWG. NO. 000-420573D	REV. NONE	REV. NO. 000-40078	SHEET 1 OF 1
HOLE LOCATION HOLE SIZE 1/8" & 1/4" 1/8" & 1/4"	L. P. JARRETT DESIGNER	08/11/90	11/16						
FINISH USED BY 00-450	J. SHARADIN 10/18/88	10/18/88	11/16						